




SCHEDULE 80

RIGID PVC CONDUIT

Size	Outer Diameter (OD)		Minimum Average Inner Diameter (ID)		Minimum Thickness (T)	
	Average		Schedule 80		Schedule 80	
	Inches	mm	Inches	mm	Inches	mm
1/2	0.840 ± 0.004	21.34 ± 0.10	0.502	12.75	0.147	3.73
3/4	1.050 ± 0.004	26.67 ± 0.10	0.698	17.72	0.154	3.91
1	1.315 ± 0.005	33.40 ± 0.13	0.910	23.11	0.179	4.55
1-1/4	1.660 ± 0.005	42.16 ± 0.13	1.227	31.16	0.191	4.85
1-1/2	1.900 ± 0.006	48.26 ± 0.15	1.446	36.72	0.200	5.08
2	2.375 ± 0.006	60.32 ± 0.15	1.881	47.77	0.218	5.54
2-1/2	2.875 ± 0.007	73.02 ± 0.18	2.250	57.15	0.276	7.01
3	3.500 ± 0.008	88.90 ± 0.20	2.820	71.62	0.300	7.62
3-1/2	4.000 ± 0.008	101.60 ± 0.20	3.280	83.31	0.318	8.08
4	4.500 ± 0.009	114.30 ± 0.23	3.737	94.91	0.337	8.56
5	5.563 ± 0.010	141.30 ± 0.25	4.713	119.71	0.375	9.53
6	6.625 ± 0.011	168.28 ± 0.28	5.646	143.41	0.432	10.97
8*	8.625 ± 0.011	219.07 ± 0.28	7.513	190.83	0.500	12.70

Rigid PVC Conduit, Schedule 80, Models - 1/2, 3/4, 1, 1-1/4, 1-1/2, 2, 3, 3-1/2, 4, 5, 6
(8* not UL Listed)

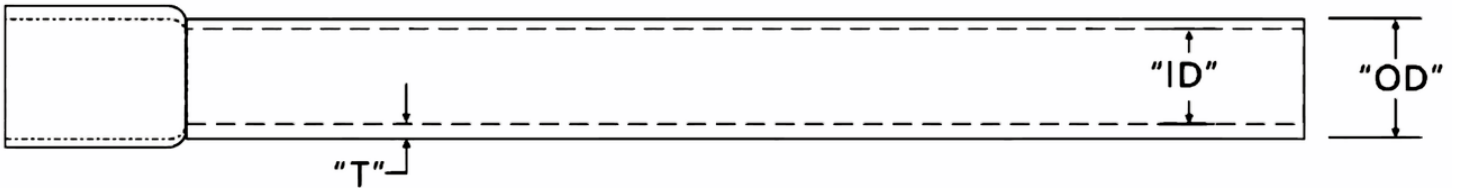

- UL 651 Listed Certification - E533526
- Conforms to NEMA TC2 Standards
- Aboveground & Underground use
- Sunlight Resistant
- Impact Resistant
- Chemical & Corrosion Resistant
- Self Extinguishing
- Standard 10ft 20ft lengths



CERTIFICATE OF COMPLIANCE

Certificate Number E533526
Report Reference E533526-20230320
Issue Date 2023-MARCH-24

Issued to: 9486-2737 QUÉBEC INC. DBA PLC PIPING
CP 75066 Succ
Cap-Rouge, QC, G1Y 3C6 CANADA

This certificate confirms that representative samples of RIGID NONMETALLIC PVC CONDUIT
See Addendum Page for Models

Have been evaluated by UL in accordance with the Standard(s) indicated on this Certificate.

Standard(s) for Safety: UL 651 - Schedule 40, 80, Type EB and A Rigid PVC Conduit and Fittings

Additional Information: See UL Product iQ® at <https://iq.ulprospector.com> for additional information.

This Certificate of Compliance indicates that representative samples of the product described in the certification report have met the requirements for UL certification. It does not provide authorization to apply the UL Mark. Only the Authorization Page that references the Follow-Up Services Procedure for ongoing surveillance provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.



Bruce Mahrenholz, Conformity Assessment Director

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact UL Customer Service at <http://ul.com/about/locations/>



CERTIFICATE OF COMPLIANCE

Certificate Number E533526
Report Reference E533526-20230320
Issue Date 2023-MARCH-24

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.



Trademark and/or Tradename: "PLC Piping",

Rigid PVC Conduit, Schedule 40, Models - 1/2, 3/4, 1, 1-1/4, 1-1/2, 2, 3, 3-1/2, 4, 5, 6

Rigid PVC Conduit, Schedule 40 with integral couplings, Models - 1/2, 3/4, 1, 1-1/4, 1-1/2, 2, 3, 3-1/2, 4, 5, 6

Rigid PVC Conduit, Schedule 80, Models - 1/2, 3/4, 1, 1-1/4, 1-1/2, 2, 3, 3-1/2, 4, 5, 6

Rigid PVC Conduit, Schedule 80 with integral couplings, Models - 1/2, 3/4, 1, 1-1/4, 1-1/2, 2, 3, 3-1/2, 4, 5, 6

A handwritten signature in black ink, appearing to read 'Bruce Mahrenholz', is written over a faint background of repeating UL logos.

Bruce Mahrenholz, Conformity Assessment Director

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact UL Customer Service at <http://ul.com/aboutul/locations/>

